



# MODERN POLYTECHNIC COLLEGE


(Approved by AICTE - New Delhi, Affiliated to DOTE Chennai)

Virudhachalam Main Road, Mahimaipuram,

Jayankondam - 621 802. Ariyalur (Dt)

Mobile : 94433 49605, 96774 03009 Email : modernpolytechnic@gmail.com, palanieswari04@gmail.com

## FIRE EXTINGUISHER

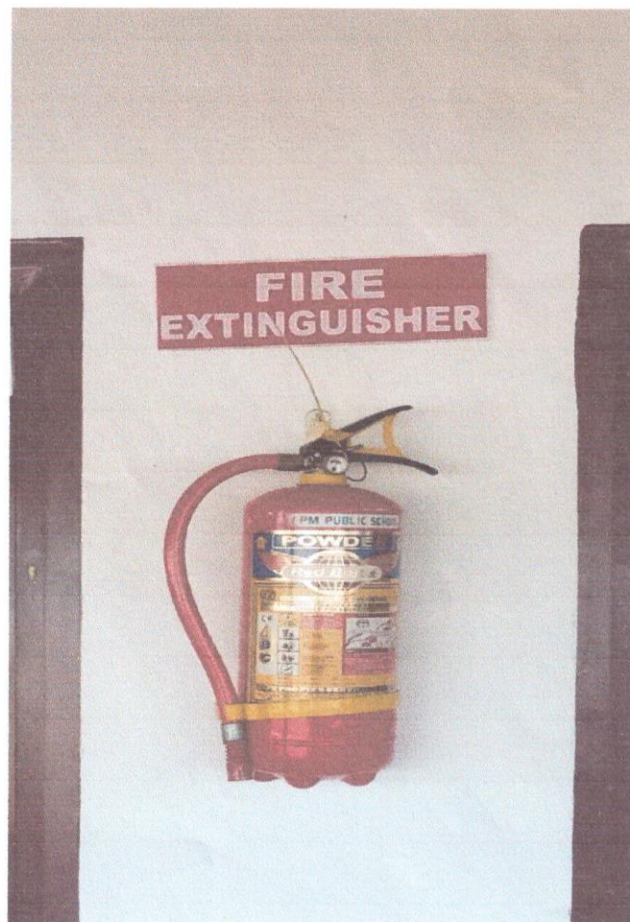

  
**PRINCIPAL**  
921 MODERN POLYTECHNIC COLLEGE,  
Mahimaipuram, Jayankondam-621 802,  
Ariyalur (Dist).

**TAMIL NADU FIRE - RESCUE SERVICES**  
**FIRE SERVICE LICENSE**

(Under Section 13 of the Tamil Nadu Fire Service Act 1985  
and with Tamil Nadu Service Rules 1990-Appendix-III)

**S.L.No:-135/2022.**

**L.Dis No:- 2829/B/2022.**

**Date:-14.06.2022.**

License is hereby granted under Section 13 of the Tamil Nadu Fire Service Act 1985, for Running a College within the jurisdiction of Udaiyarpalayam Taluk, S.F.No:- 518/1, 275/2A, 2B, 276/3A at the premises **M/s.Modern Polytechnic College**, Viruthachalam Road , Keelakudiruppu Village, Jayankondam, Udaiyarpalayam Taluk , Ariyalur District. 621802. Subject to the conditions noted thereon and other conditions as may be prescribed.

The above Premises Inspected By Mr.A.Mohanraj, Station Officer- Jayankondam on: 02.06.2022.

**CONDITIONS**

As per Col.13 of Appendix V to the Rules under section 13 of the Act

1. This License is valid for one year from the date of issue.
2. Installed fire and safety systems should be maintained as per NBC -2016 Part -4 fire safety code of practice.
3. The applicant will also get permission / No objection certificate from other department if necessary.
4. If the extension or alteration is made in the existing building and also for Changing of present business will also apply & get separate permission.
5. Regular License has to be obtained from competent authority.
6. All the fire extinguishers have to be recharged and maintained Periodically as per code of practice in IS: 2190/2010.
7. Advise to train the employee to operate the Fire Extinguisher.
8. A terrace tank with capacity of 5000 litres and 450 Lpm terrace pump should be provided.
9. Hose reel system should be provided
10. If there is any deviation from the Govt.rules and act the license stand cancelled.

(Office Seal with Date)



*U. Jey*  
14/6/2022  
District Officer

Fire and Rescue Service,  
Perambalur District,  
Perambalur. 2/14/6/22

**To:-** M/s.MODERN POLYTECHNIC COLLEGE,  
Viruthachalam Road , Keelakudiruppu Village, Jayankondam,  
Udaiyarpalayam Taluk ,  
Ariyalur District. 621 802.

Copy to: Deputy Director, Fire and Rescue Service, Central Region, Tiruchirappalli.